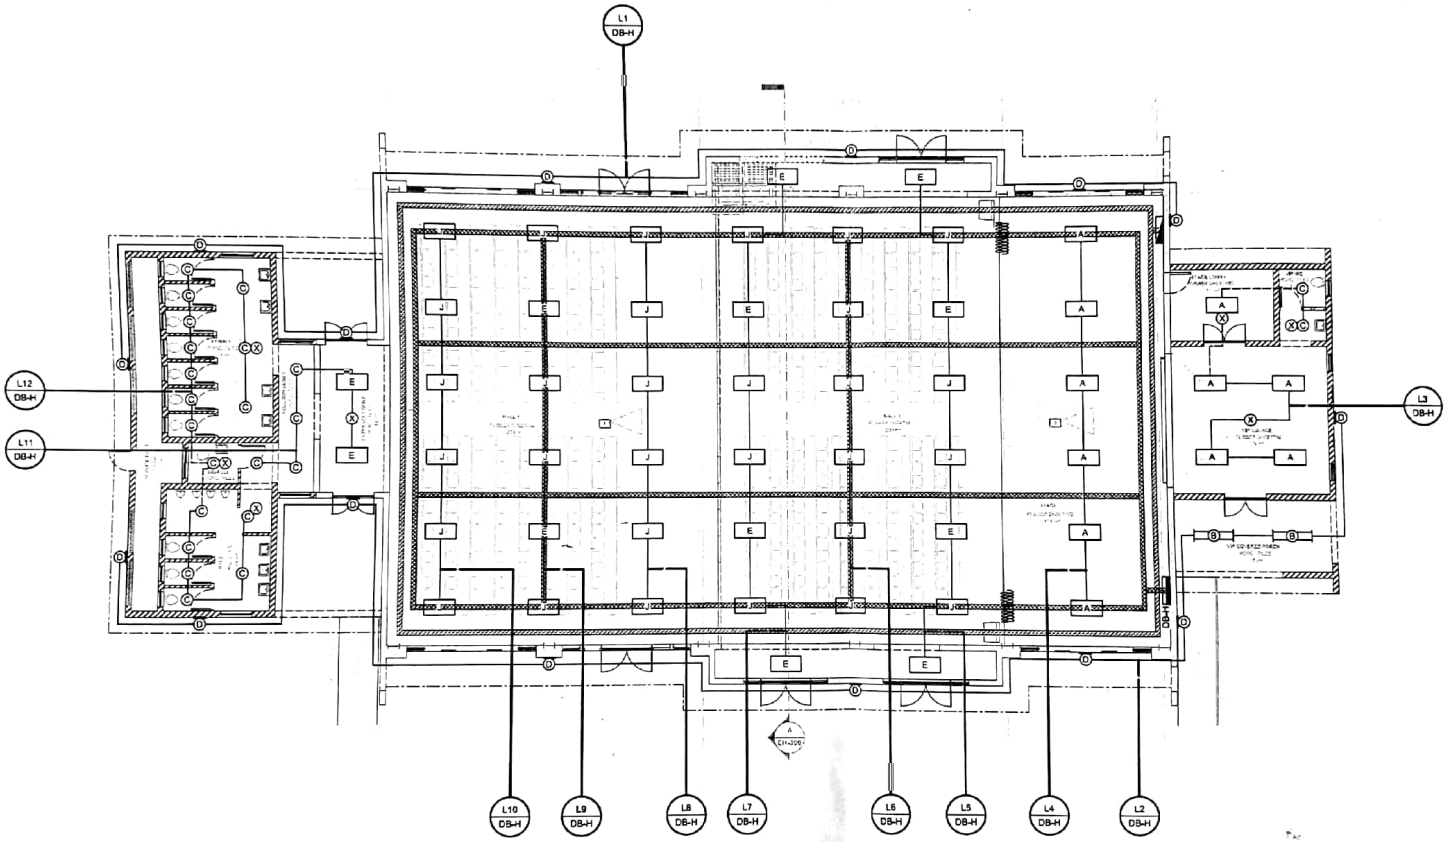

ELECTRICAL SYMBOLS

- DISTRIBUTION BOARD
- DATA DISTRIBUTION BOARD
- LINEAR LIGHT FITTING
- RECESSED LIGHT FITTING
- DOWN LIGHT FITTING
- WALL MOUNTED LIGHT FITTING
- LIGHT SWITCH
- TWO WAY LIGHT SWITCH
- DRAWBOX
- TELEPHONE OUTLET
- DATA OUTLET
- 1x 16A CONVENTIONAL SSO (SANS 164-1)
  1x 16A IEC SOCKET OUTLET (SANS 164-2)
- 2x 16A CONVENTIONAL SSO (SANS 164-1)
  2x 16A IEC SSO (SANS 164-2)
- 16A CONVENTIONAL DOUBLE SWITCHED SOCKET OUTLET (SANS164-1)
- 16A DEDICATED SWITCHED SOCKET OUTLET (SANS164-4)
- SINGLE PHASE OUTLET 20A DOUBLE POLE ISOLATOR
- THREE PHASE OUTLET 20A THREE POLE ISOLATOR
- 100x50x50 DRAWBOX BEHIND POWERSKIRTING WITH 2x25mmØ CONDUIT TO WIRE MESH BASKET (DATA/TEL)
- 100x50x50 DRAWBOX BEHIND POWERSKIRTING WITH 2x25mmØ CONDUIT TO WIRE TRUNKING (POWER)
- CLUSTER INSTALLED ON POWERSKIRTING COMPLETE WITH:
  3x 16A CONVENTIONAL SSO (SANS 164-1)
  3x 16A IEC SO (SANS 164-2)
  3x 16A DEDICATED SSO (SANS164-4)
- CLUSTER INSTALLED ON POWERSKIRTING COMPLETE WITH:
  2x 16A CONVENTIONAL SSO (SANS 164-1)
  2x 16A IEC SO (SANS 164-2)
  2x 16A DEDICATED SSO (SANS164-4)
- CONDUIT
- INDICATES SWITCHING
- INDICATES CIRCUIT
- SLEEVE PIPES
- INDICATES DEDICATED CIRCUIT
- 2 COMPARTMENT POWERSKIRTING
- 41mm x 41mm WIRING TRUNKING
- 300mm WIDE WIRE MESH BASKET
- L1 DB-X — CIRCUIT INDICATOR

DATE DATUM	NO.	DESCRIPTION	CHKD. APPR.

WYSIGINGS / AMENDMENTS

PIENAAR & ERWEE

CESA

MEETHLINDSTRAAT 3 MEETHLING STREET
BENDOR, POLOKWANE
0699

POSTNET SUITE 100
PRIVATE BAG X9678
POLOKWANE
0700

PROJECT:
LIMPOPO TRAFFIC TRAINING COLLEGE

TRIENDNAMING:
EXISTING HALL RENOVATIONS:
GROUND FLOOR:
ELECTRICAL INSTALLATION:
LIGHT LAYOUT

W DE KOCK	REV		
1:100	A1	S1409/300/01	

0496

Scanned with CamScanner